
THREE PHASE TRANSFORMER CONCRETE PADS

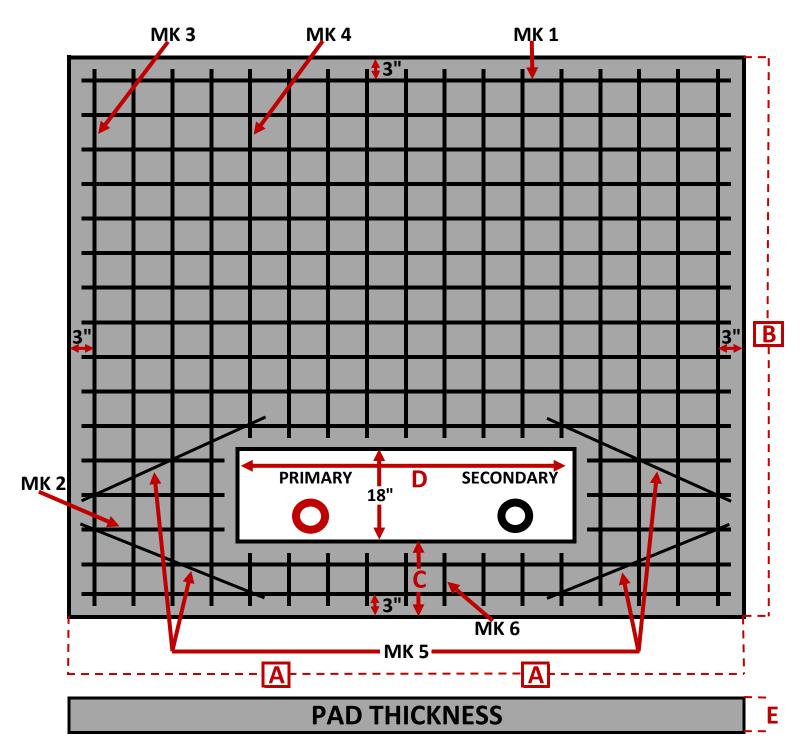

3-PHASE	DIMENSION IN INCHES					REINFORCING BARS					
TRANSFORMER PADS	Α	В	С	D	E	MK 1	MK 2	MK 3	MK 4	MK 5	MK 6
ALL	104"	100"	10"	CHECK WITH	8"	13 #4	6 #4	8 #4	9 #4	4 #4	9 #4
				TVEC		98"	19"	94"	66"	29"	5"

- 1. Concrete testing, 4,000 pounds per square inch; 4% to 6% entrained air, 3/4 maximum size aggregate.
- 2. Reinforcing steel, ATSM-A615 grade 60, place approximately 6" from each other and securely tied together.
- 3. Minimum concrete cover over reinforcing steel is 2" unless otherwise noted.
- 4. Wood float finish, leaving no depressions.