



UNDERGROUND TEMPORARY SERVICE

ALL TEMPORARY POLES WILL BE SPOTTED BY TVEC

FRONT VIEW OF DISCONNECT

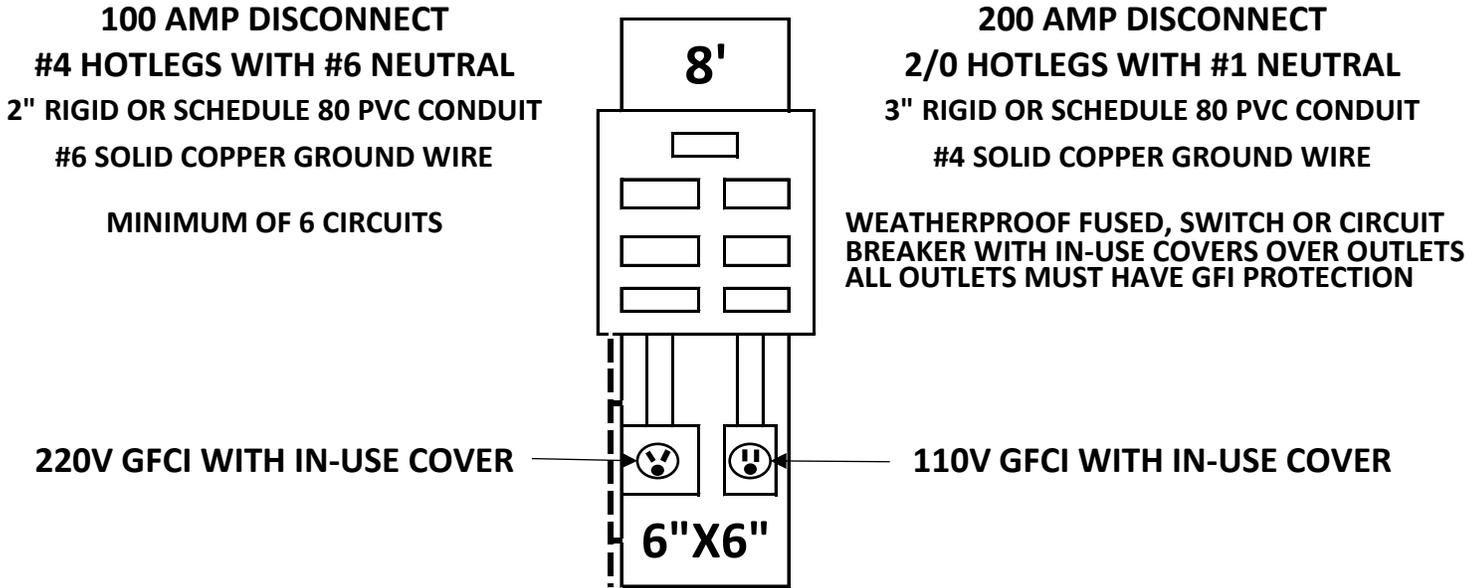

SIDE VIEW OF UNDERGROUND TEMPORARY POLE

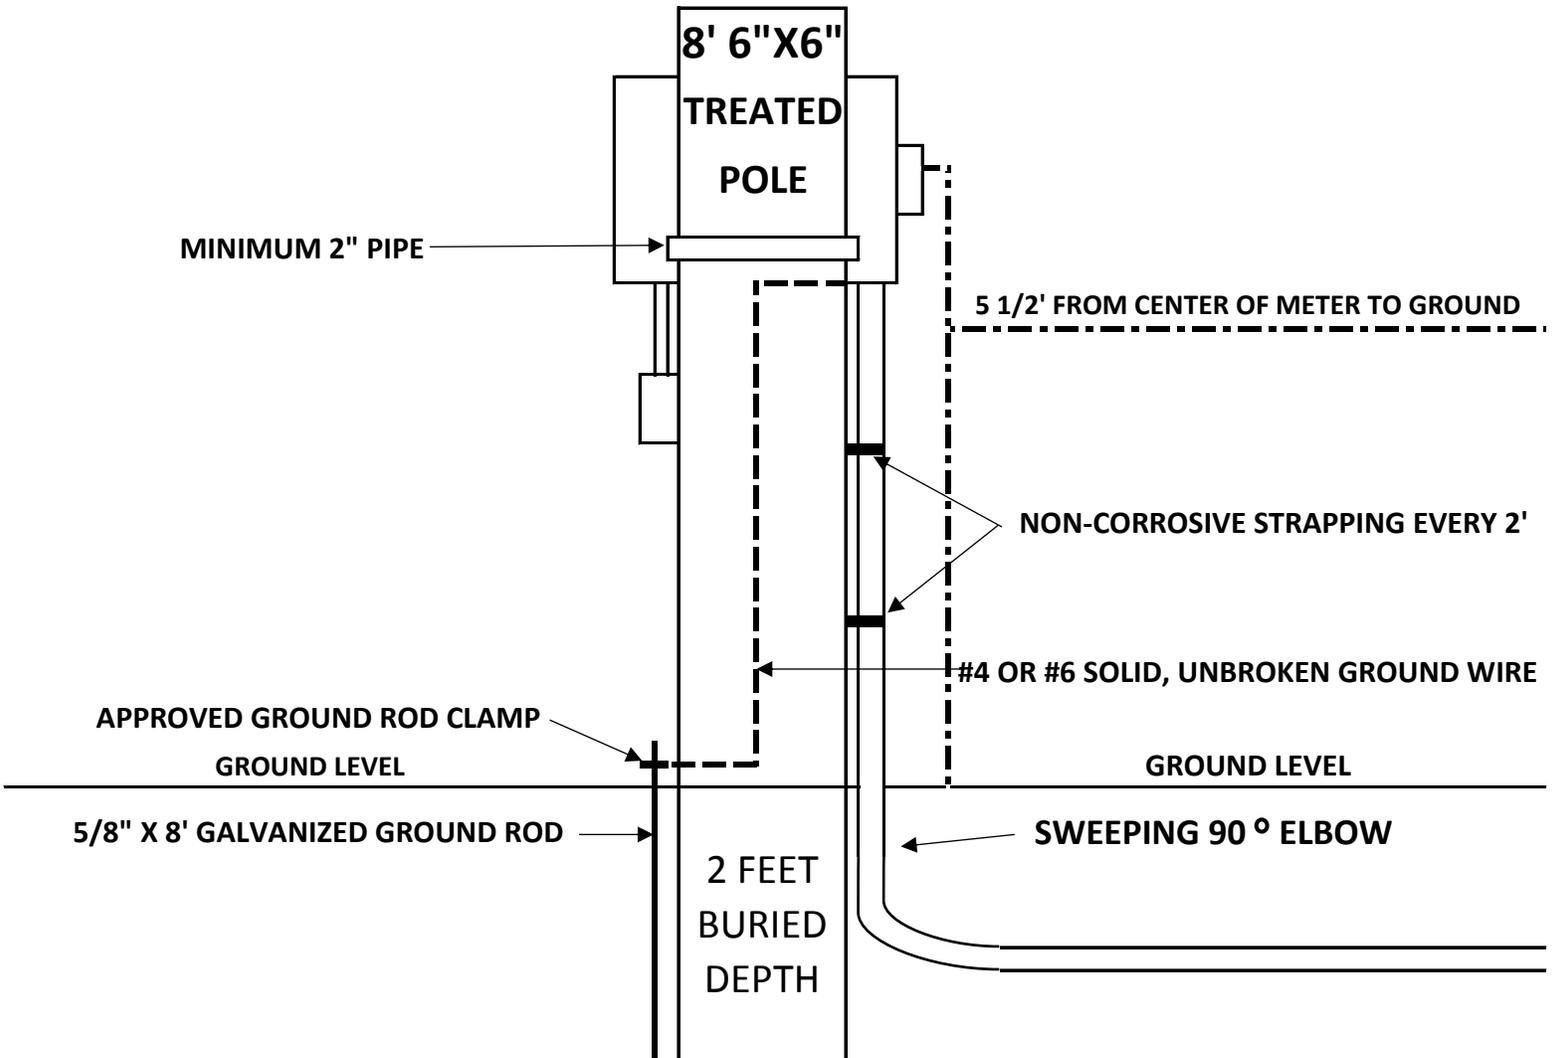

All wiring must meet State of Tennessee wiring code and the National Electric Code (NEC). T.V.E.C. will not connect to a meter pole until approved by Tennessee deputy state inspector